








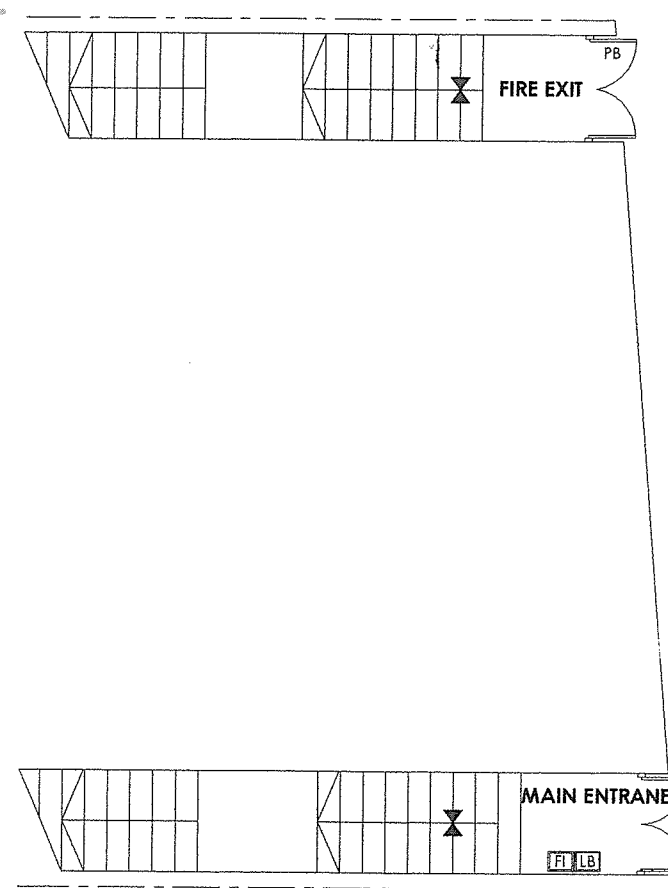



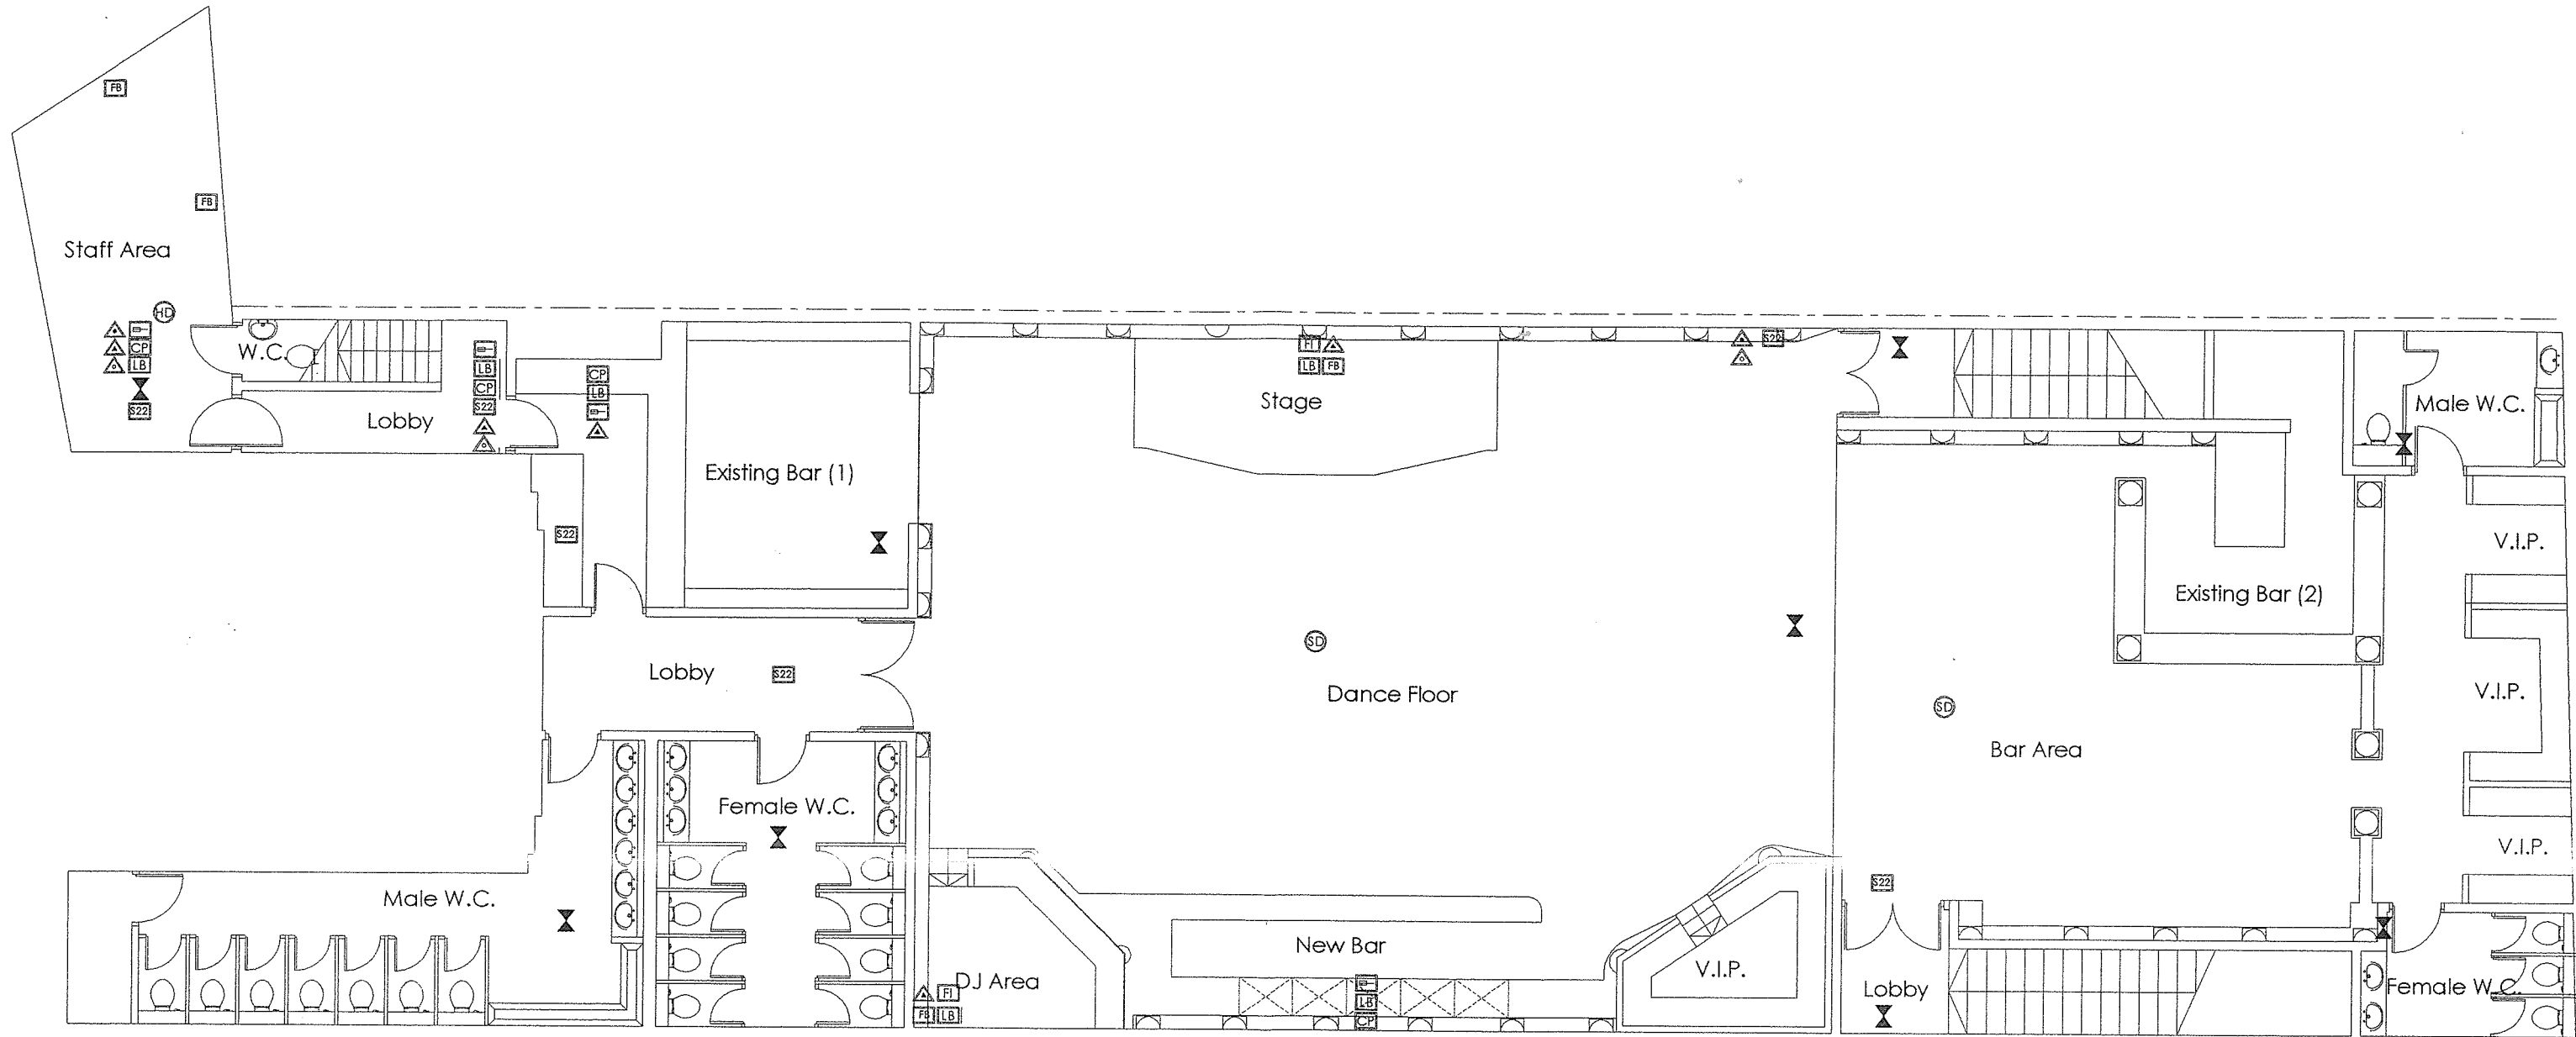


UPPER GROUND FLOOR PLAN
















GROUND FLOOR PLAN

-  60 MINS FIRE CHECKED SELF CLOSING DOORS
-  SMOKE DETECTION TO BS 5839
-  HEAT DETECTION TO BS 5839
-  FIRE ALARM CALL POINT WITH INSTRUCTIONS TO BS 5839
-  FIRE INSTRUCTIONS
-  LIGHT AND BUZZER UNIT TO BS 5839
-  EMERGENCY LIGHTING TO BS 5499
-  FIRE EXIT TO BS 5499
-  FOAM EXTINGUISHER
-  CARBONE DIOXIDE
-  WATER
-  FIRE BLANKET





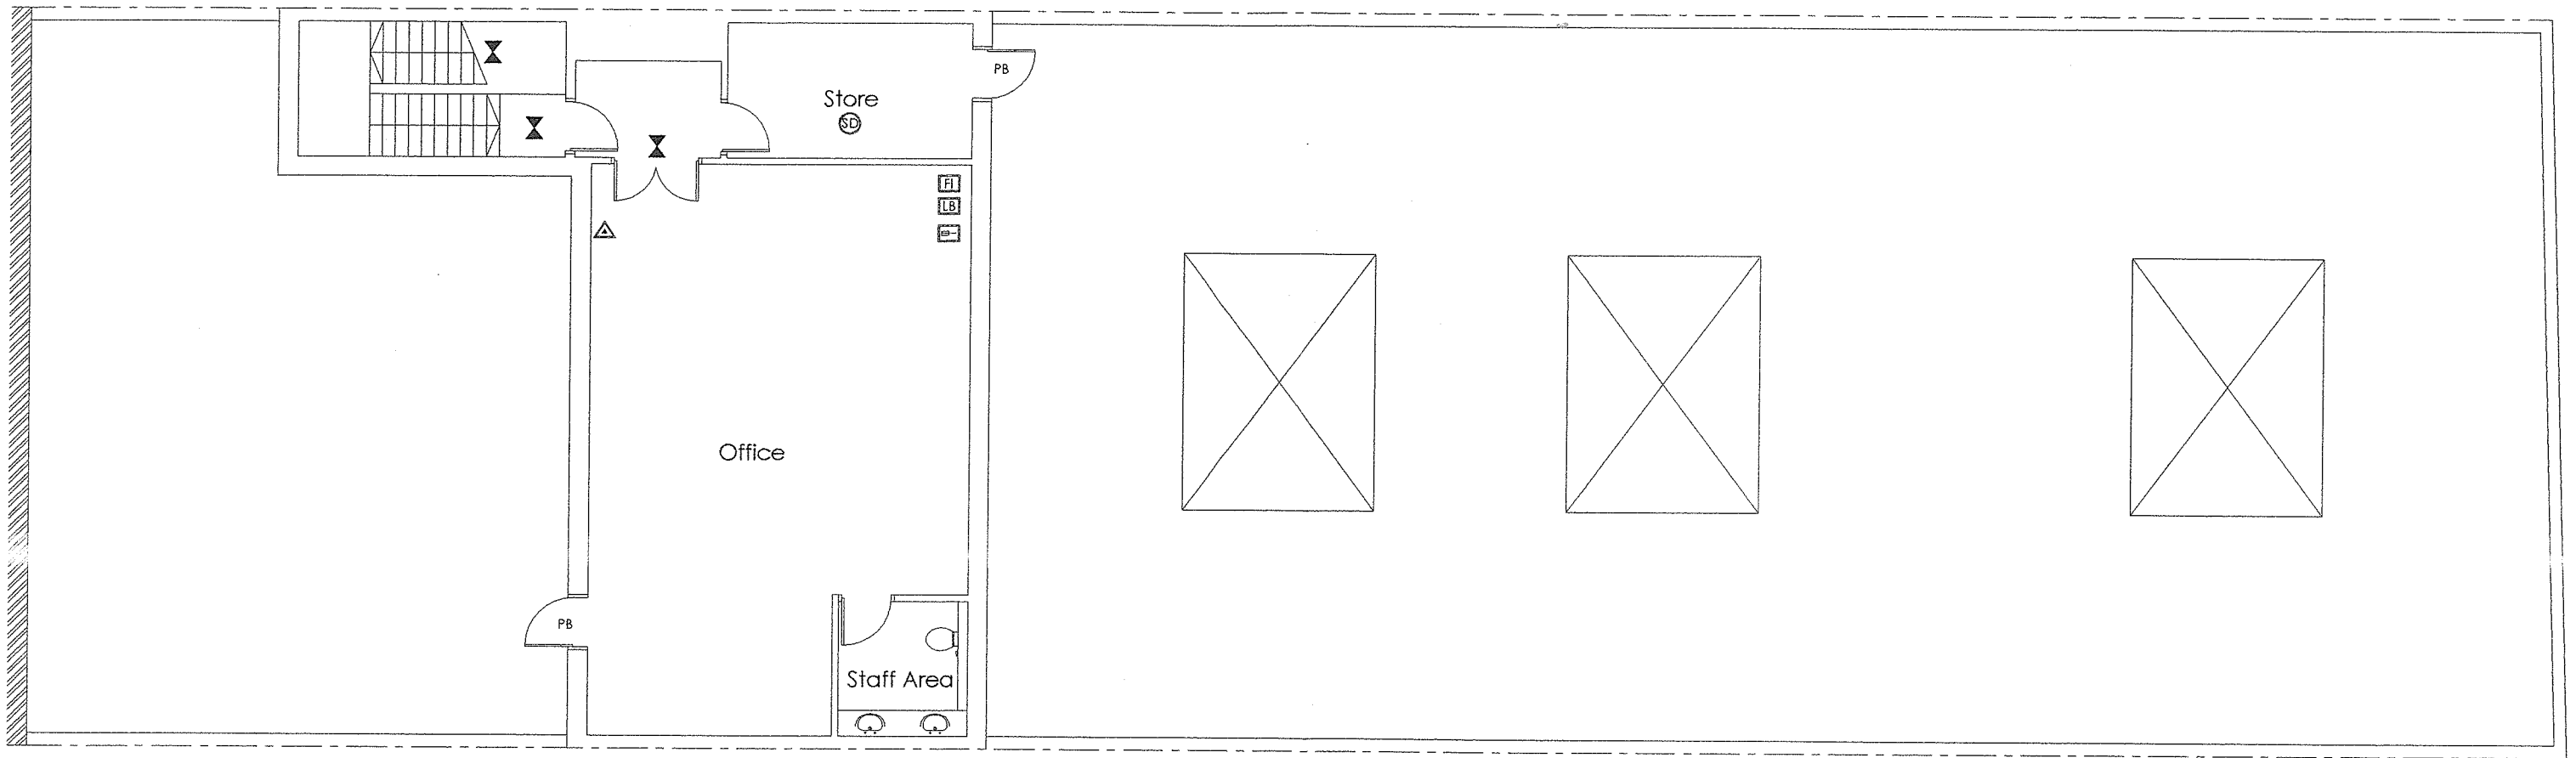









1ST FLOOR PLAN

-  60 MINS FIRE CHECKED SELF CLOSING DOORS
-  SMOKE DETECTION TO BS 5839
-  HEAT DETECTION TO BS 5839
-  FIRE ALARM CALL POINT WITH INSTRUCTIONS TO BS 5839
-  FIRE INSTRUCTIONS
-  LIGHT AND BUZZER UNIT TO BS 5839
-  EMERGENCY LIGHTING TO BS 5499
-  FIRE EXIT TO BS 5499
-  FOAM EXTINGUISHER
-  CARBONE DIOXIDE
-  WATER
-  FIRE BLANKET



2ND FLOOR PLAN

-  60 MINS FIRE CHECKED SELF CLOSING DOORS
-  SMOKE DETECTION TO BS 5839
-  HEAT DETECTION TO BS 5839
-  FIRE ALARM CALL POINT WITH INSTRUCTIONS TO BS 5839
-  FIRE INSTRUCTIONS
-  LIGHT AND BUZZER UNIT TO BS 5839
-  EMERGENCY LIGHTING TO BS 5499
-  FIRE EXIT TO BS 5499
-  FOAM EXTINGUISHER
-  CARBONE DIOXIDE
-  WATER
-  FIRE BLANKET