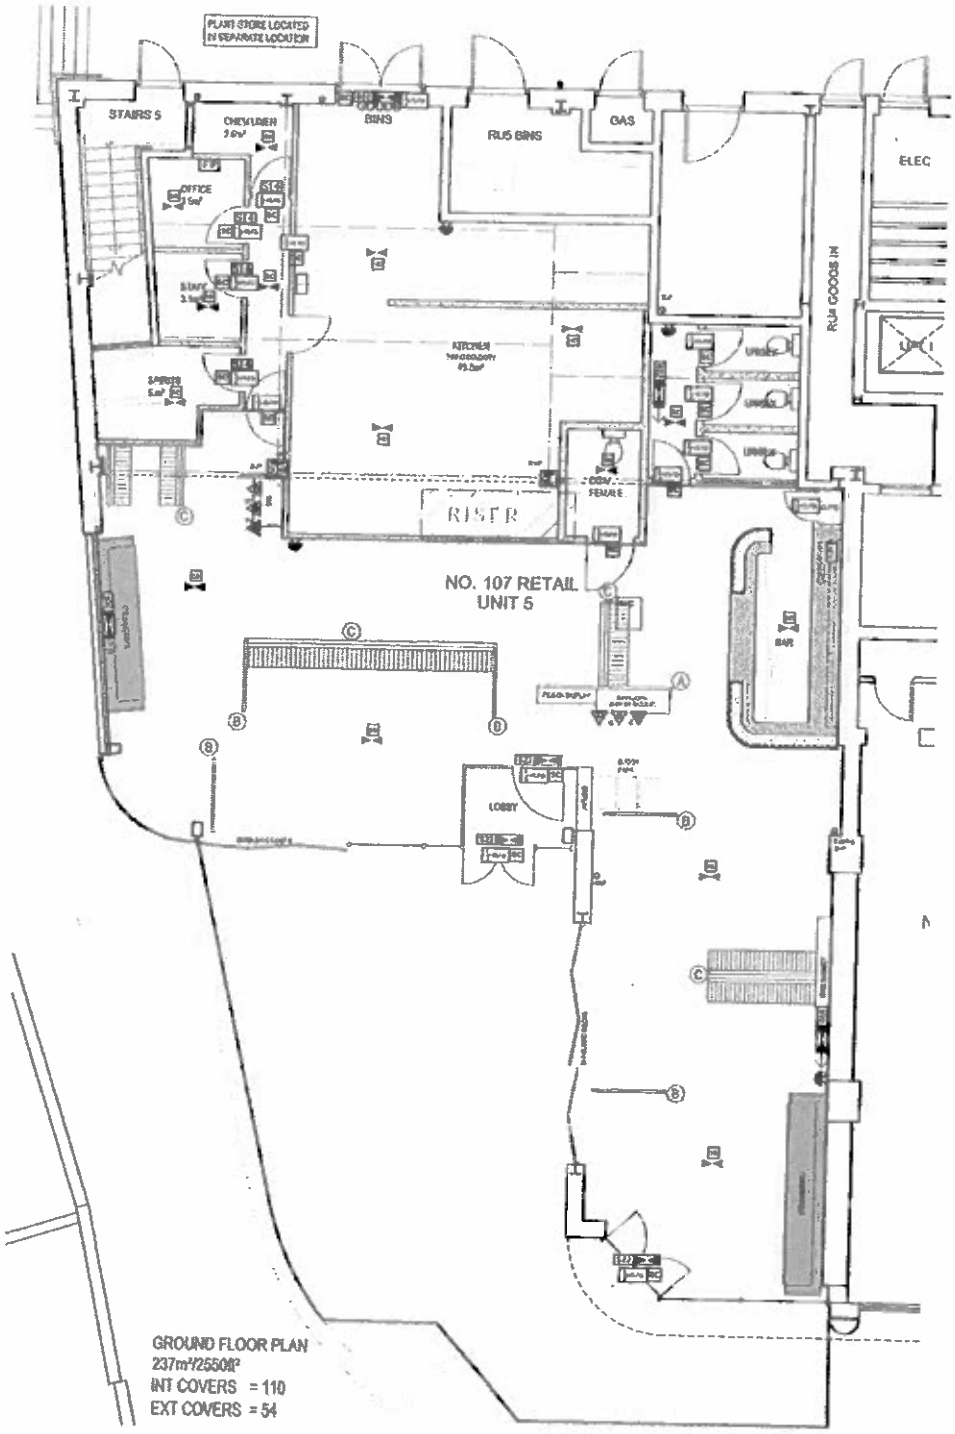

FIRE ALARM PANEL

LIGHTING SYSTEM

EMERGENCY LIGHTING SYSTEM

FIRE ALARM SYSTEM

FIRE FIGHTING EQUIPMENT & SIGNS

FIRE ALARM CIRCUIT SCHEDULE

INTERFACE TO HVAC PANEL

SPRINKLER SYSTEM NOT REQUIRED

ELECTRICAL CONTRACTOR TO LIAISE WITH MC REGARDING POWER E.T.C. UP WITH ALL OTHER AREAS OF THE FLOORS ABOVE - M/C TO CHECK WITH CLIENT REQUIREMENTS BY LANDLORD

BELL CIRCUIT 1 - LOCAL 10 PANEL - GROUND FLOOR

BELL CIRCUIT 2 - N/A

Red line indicates demise of Bill's Restaurant

FIRE CURTAIN

© 2019 CHAMELEON MANAGEMENT LTD. All rights reserved.

CHAMELEON MANAGEMENT Ltd

PumpHouse DESIGNS

Architectural Consultants

BILL'S RESTAURANT
UNIT 5
MUSWELL HILL
LONDON

PROPOSED GROUND PLAN

DRAWN BY - S LAWRENCE
DATE - MARCH 2019
SCALE - 1:50 @ A1

DRAWING No. 4322 / 001 / 501